


BUILDERS WORK NOTES

- 1- FORM PERMANENTLY WATER TIGHT PIT.
- 2- LIFT SHAFT TO BE CONSTRUCTED OF NON-COMBUSTIBLE MATERIALS THAT DO NOT ASSIST THE CREATION OF DUST.
- 3- DIMENSIONS ON PLAN ARE MINIMUM CLEAR PLUMB SIZES TO ACCOMMODATE THE LIFT AND ITS RELATED EQUIPMENT.
- 4- ALL HEIGHT DIMENSIONS ARE TAKEN FROM FINISHED FLOOR LEVEL
- 5- LIFT SHAFT LIGHTING: PROVIDE BULKHEAD LIGHTS 500 mm FROM TOP AND BOTTOM OF LIFT SHAFT AND ONE IN CENTRE, WITH 2 WAY SWITCHES IN LIFT PIT AND PUMPROOM.

NOTA: I MRE

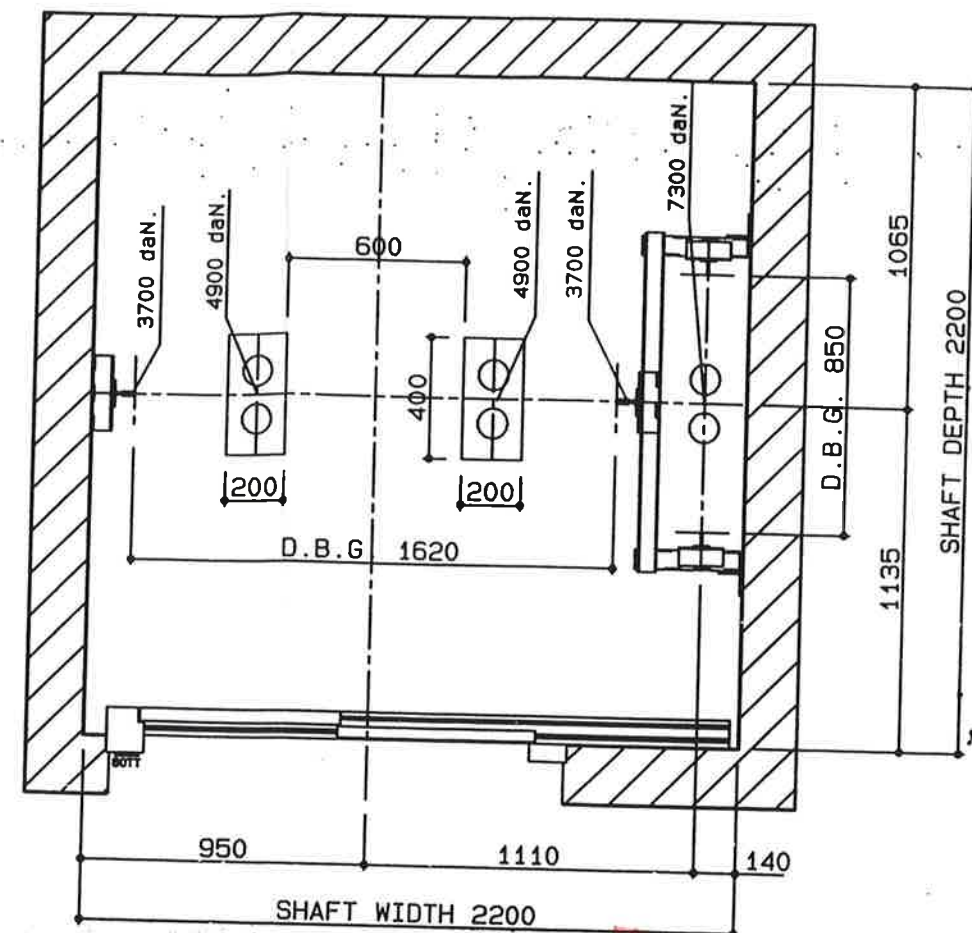

BE CAREFUL

PROVISION SHALL BE MADE, AT THE TOP OF THE WELL,
FOR VENTILATION OPENINGS, WITH A MINIMUM AREA OF
1 % OF THE HORIZONTAL CROSS SECTION OF THE WELL
TO THE OUTSIDE EITHER DIRECTLY OR VIA THE MACHINE.

MACHINE ROOM SHALL BE VENTILATED.
STALE AIR FROM OTHER PARTS OF THE BUILDING SHALL
NOT BE EXTRACTED INTO THE MACHINE ROOM.
THE AMBIENT TEMPERATURE IN THE MACHINE ROOM SHALL
BE MAINTAINED BETWEEN + 5°C AND +40°C.

THE DIMENSION OF THE HOLES IN THE SLAB AND ROOM FLOOR SHALL BE REDUCED TO A MINIMUM. FERRULES SHALL BE USED, WHICH PROJECT AT LEAST 50 mm. ABOVE THE SLAB OR FINISHED FLOOR

NOTES

180

100

 200 x 150

NOTA 1 :

NOTA 2 : SPEED GOVERNOR [360 x 170 x h. 400] .
NOTA 3 :

NOTA 3 :

NOTA 4 : CONTROL PANEL FULLY INSPECTION FROM SIDE
NOTA 5 : STEERS TO GO DOWN ON THE

NOTA 5 : STEEPS TO GO DOWN IN PIT 400 x 100 x 100

NOTE 6 : MACHINE ROOM ENTRANCE HAS TO BE DIRECT NO OBSTRUCTION
NOTE 7 : LIGHT SWITCH

NOTE 7. LIGHT SWITCH

NOTA B :

NOTA 9 : WINDOW FOR VENTILATION

DO NOT USE DIMENSION SCALE DRAW